



5 Fitting the earth



1. In the case of aluminium wire armour, place a support ring under the armour wires.

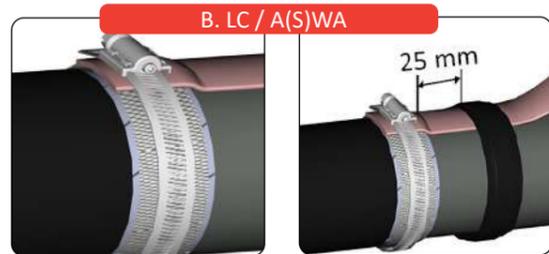


2. If required, wind 3 layers of gauze over the armour (wires or tape). Fix the 16mm² braid to the armour with a jubilee clip.




3. Fit the 16mm² and 50mm² braid to the lead sheath with a constant force spring or LDV-clamp and tape up the connection with PVC tape.




6. Fit the 6mm² and 50mm² braid to the lead sheath with a constant force spring or LDV-clamp.

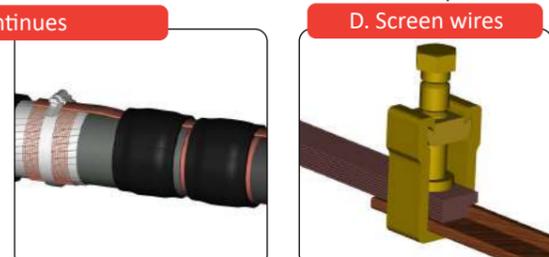


7. Run the main braid over the tape screen and fix it by means of a constant force spring. Tape up the constant force springs.

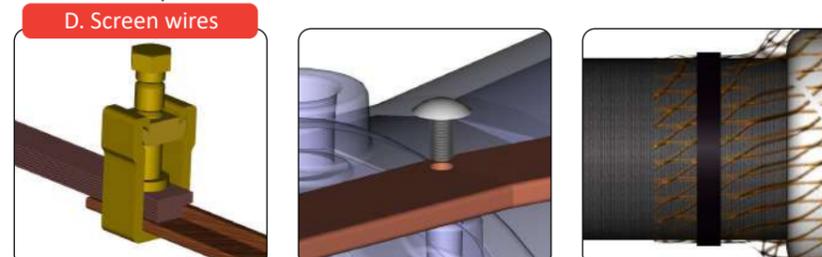

8. Connect the screen wires of the polymeric cables to the braid by means of an earth connector.

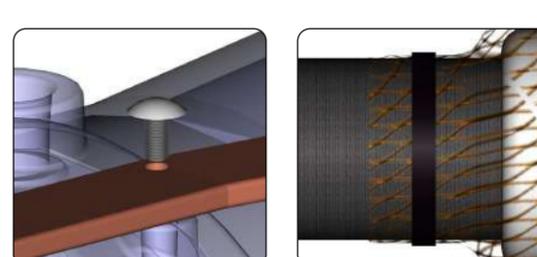


9. Fix the braid to the inner shell with the plastic nails provided.




10. Pull the earth stocking over the inner joint and fasten the earth screen on both sides with a plastic tie wrap.

6 Assembly of outer joint

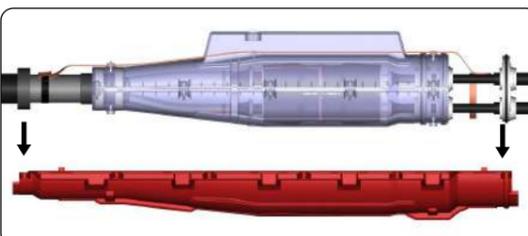

1. Position the lower shell and mark the positions of the self-amalgamating tape and plate as on the inner joint.

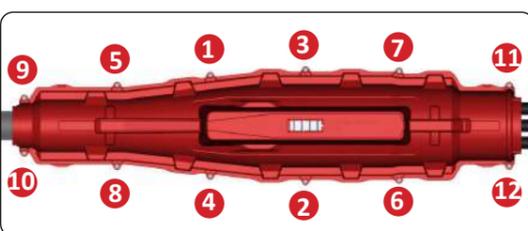

4. Place the upper shell and fix the screws according to the image above.

7 Filling the outer joint with Protolin®

! Support the joint and cables with sand.




1. Mix the Protolin® resin according to the instructions on the bag and pour via one of the fill openings.




2. Push the cover in the filling hole. Cover the joint with sand and put into service according to the instructions of the network administrator.

! First few windings firmly!



2. Wind the self-amalgamating tape. Check the correct diameter using the Lovink (slide) callipers.



3. By using foam build-up tape (grey), tape up the cables to the correct diameter and slide the plate onto the center.

LoviSil® M-series

Installation instruction




3 - core PILC
3x1 - core XLPE

U0 / U (U_{max})

19 / 33 (36) kV

Conductor cross-section 70 - 400 mm²

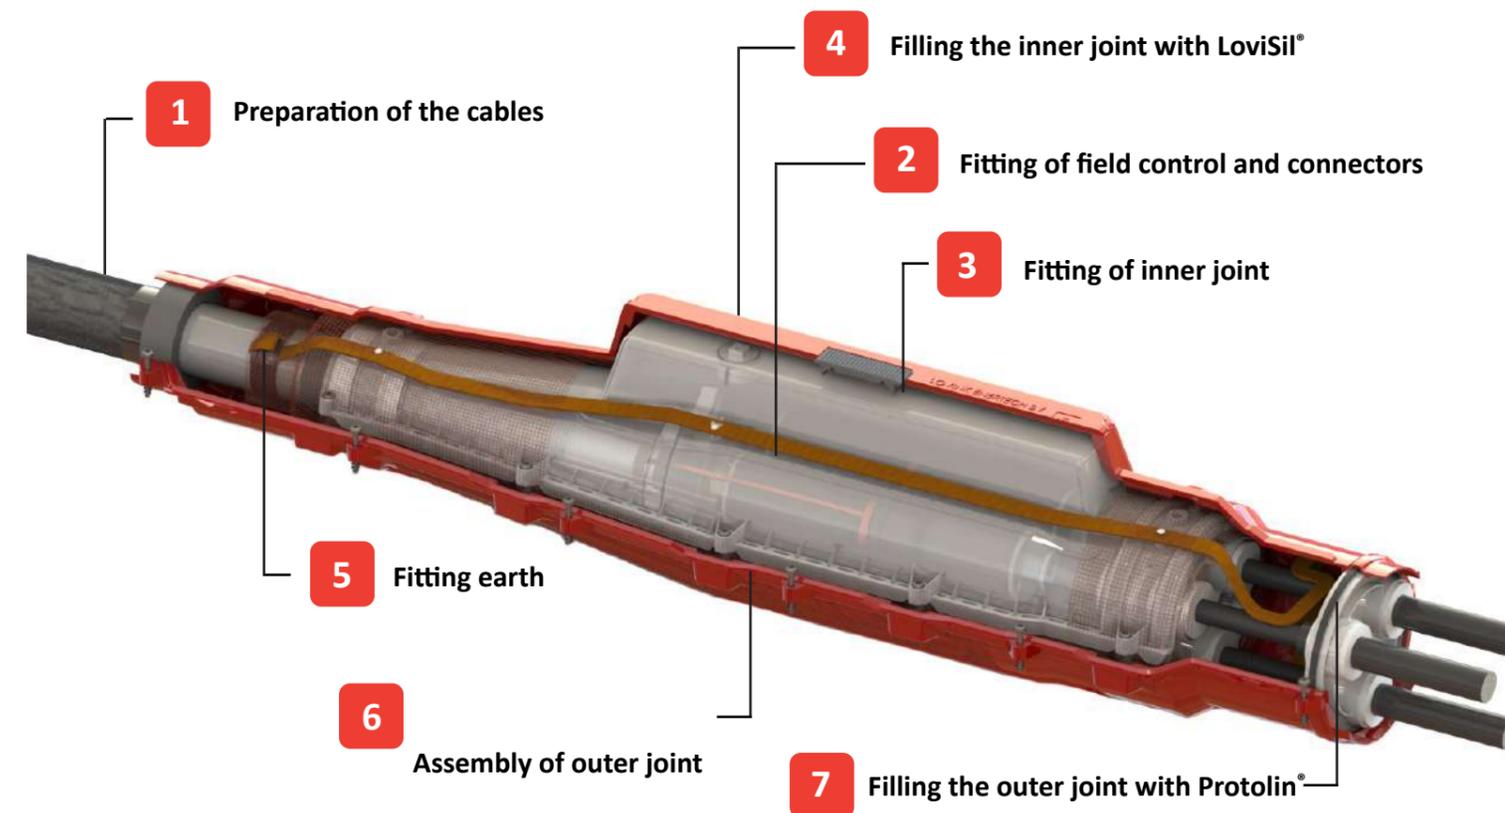

General remarks



Follow any **safety instructions** issued by the network administrator and/or your employer!



Check whether the **paper-insulated cable** contains any moisture according to the instructions of the network administrator and/or your employer!



Make sure the connection stays **dry and clean** all through the assembly!



This instruction is meant as a guideline for **trained and certified jointers**. Knowledge of medium voltage technology and experience in cable preparation should be present!




Note the **correct dimensions** as mentioned in this instruction when installing the joint!

Disclaimer: Lovink Enertech takes the utmost care in the production and assembling of this installation instruction, but can in no way guarantee the accuracy or completeness. Lovink Enertech accepts no responsibility for damage of any kind caused by not following the installation steps described in this instruction. Lovink Enertech reserves the right to modify the contents of this publication or remove parts at any time without having to give notice.


1 Preparation of the cables

Three core cables

a. PILC

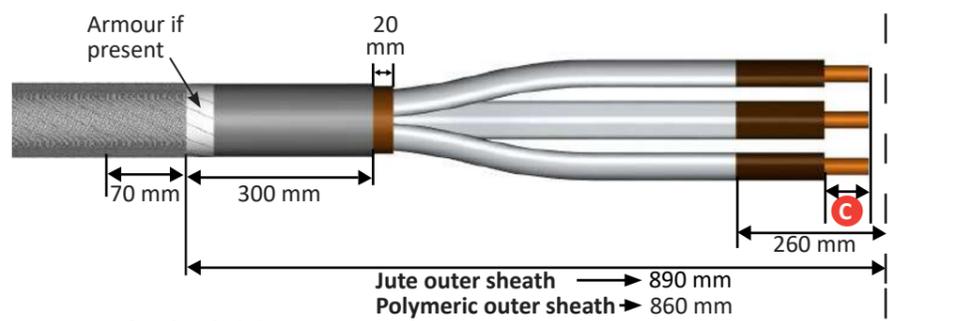


b. XLPE/TS/LC/A(S)WA

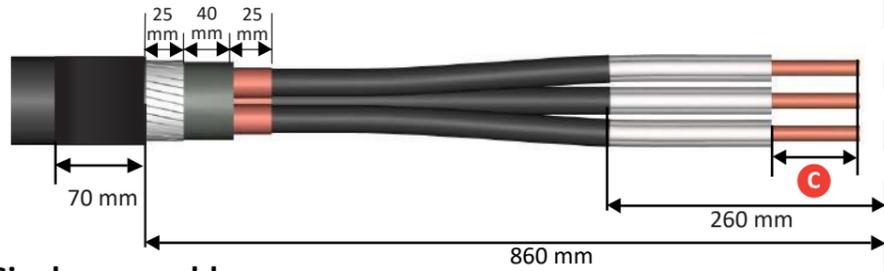


Single-core cables

a. XLPE/TS/LC/A(S)WA

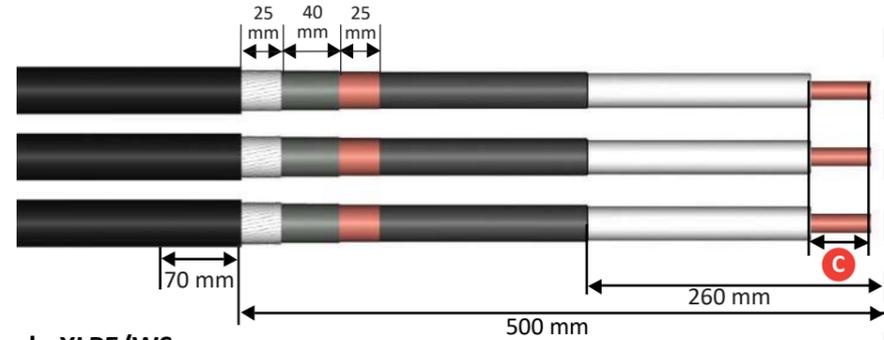

b. XLPE/WS

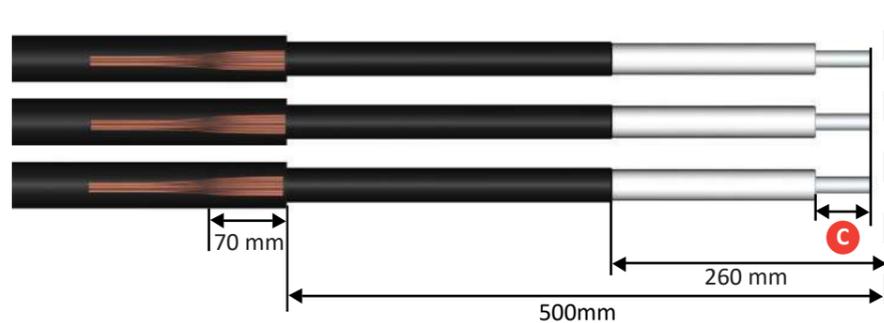

Dimensions connectors


With blocked connectors:
½ connector + 5 mm

Without blocked connectors:
½ connector + 10 mm

! Always abrade polymeric outer sheath (70mm) and/or lead sheath!(300mm).



! If necessary, make a **crossing** outside the joint on the single-core side.

! Bend the screen wires back but **do not** cut them!

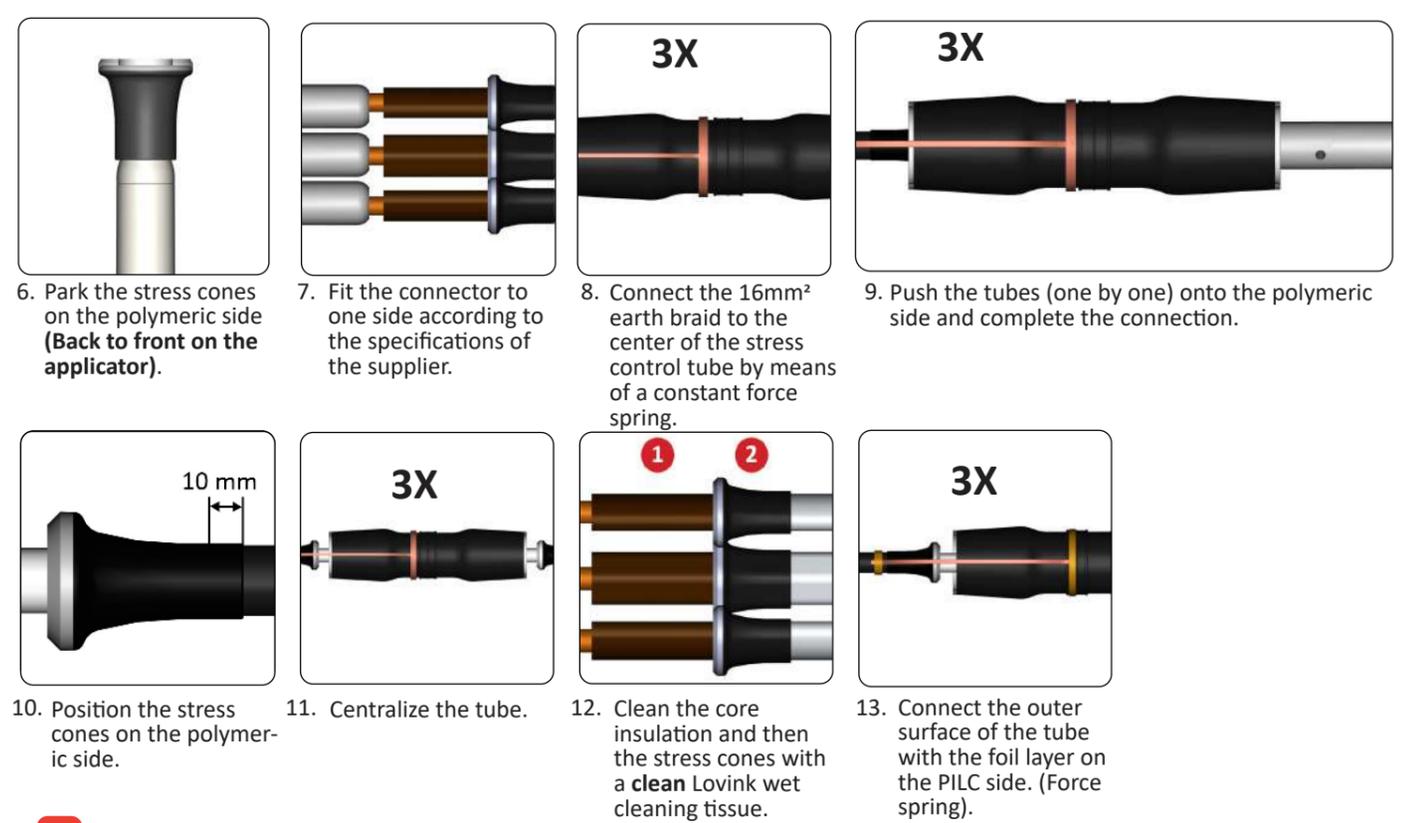


3 Fitting of inner joint

! Clean all parts using a Lovink cloth before closing the inner shell !!

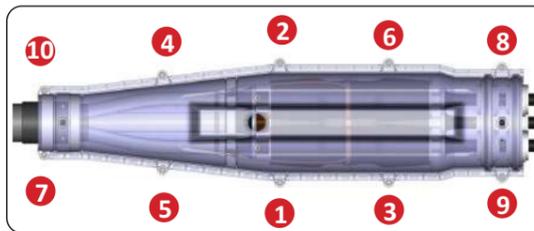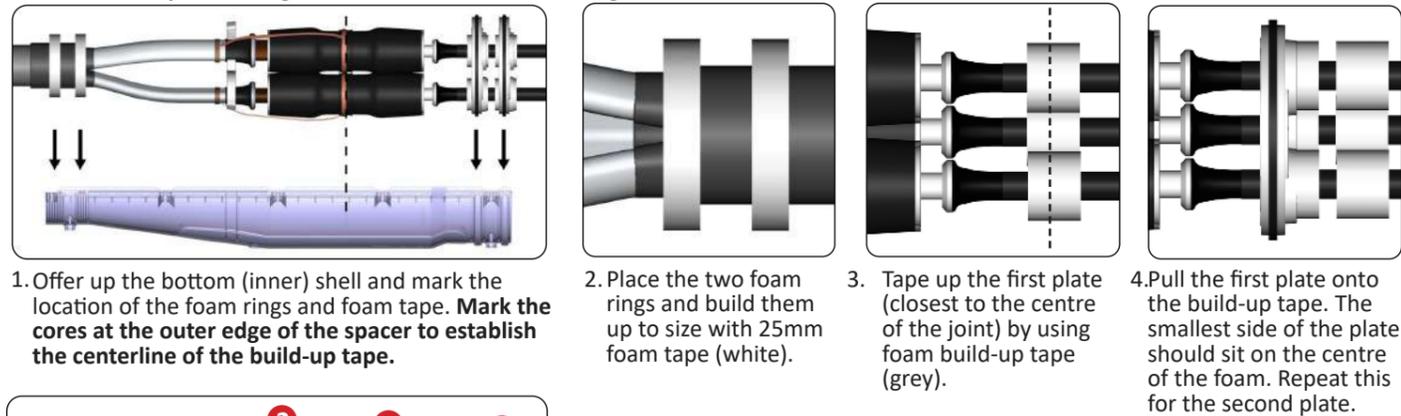

5. Place the second plate as the first. While flexing the bottom shell, place it over the foam rings. Place the top shell and fix all screws in the order given above.

4 Filling the inner joint with LoviSil®

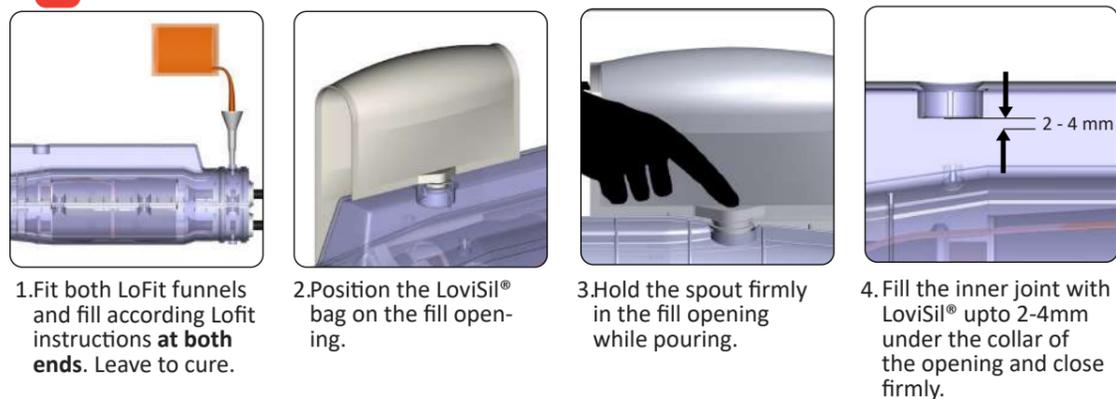

2 Fitting of field control and connectors

